

CRAY-1 COMPUTER

PRELIMINARY SITE PLANNING

CRAY-1 COMPUTER

The computer consists of the mainframe (CPU), power cabinet, two condensing units, and two motor-generators and control cabinets.

Computer room environment:

60° F to 80° F (16° C to 27° C) 35% to 65% R.H.

Voltages required:

480 volt 60 Hz

False floor:

12-inch (30.5 cm) minimum height (subfloor to top of false floor) Floor to be grounded to earth ground.

Site access requirements:

Doors:

Double doors with minimum clearance of 80-inch (203 cm) height and 60-inch (152 cm) width. If ramp and door are in close relationship required door height may be greater.

Ramp:

Maximum slope of 1 in 5.

General:

Access route to site must be strong enough to support rolling casters with 1500-pound loads. That applies especially to any ramps where the unit is most vulnerable. Customer should have 1/4-inch thick Masonite (not plywood) available for covering false floor and tiled areas during the moving-in process.

Description:

Refrigerant-cooled unit that contains the modules and D.C. power supplies. Unit breaks down into one piece approximately 54 inches (137 cm) in diameter by 75 inches (191 cm) high, plus six power supply sections of slightly triangular shape of roughly 38 inches (97 cm) by 24 inches (61 cm) by 18 inches (46 cm) high. Entire assembled unit weighs about 10,000 pounds (4536 kg), with the center part of the unit weighing 6000 pounds (2722 kg). Floor loading for the center section is 7 pounds to the square inch $(.5 \text{ kg/cm}^2)$.

Wiring (see Power Wiring schematic):

Unit requires thirty-six 3-wire circuits to the power cabinet plus two optional 115-volt circuits for convenience outlets. All additional cables are furnished by Cray Research, Inc.


Cooling (see Underfloor Refrigeration drawing):

Refrigerant piping must be installed, tested, and ready for hookup prior to the computer delivery. CRI will attach hoses between the prepared lines and the computer during the installation.

Floor preparation (see Floor Cutout drawing):

Unit requires accurate placement and sizing of floor cutouts.

All floor stringers so noted must be removed and additional floor supports added where specified.

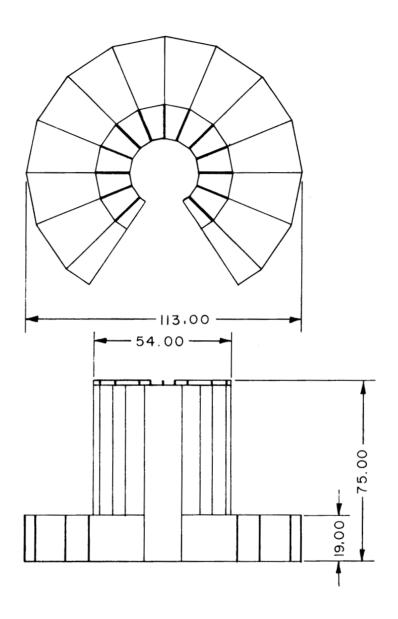

CRAY I COMPUTER CPU

POWER REQ'D: TWO, 15 AMP, 115 V, 60 Hz CIRCUITS (MAIN COMPUTER POWER FROM POWER CABINET)

APPROX. WT.: 10,000 lbs

CRAY-1 POWER CABINET

Description:


Fan-cooled (room air) unit that contains the power supplies variable transformers, system ON-OFF control, warning circuits, temperature monitoring, plus other related functions.

Wiring (see Power Wiring schematic):

Customer to install 400-Hz and 60-Hz circuits, motorgenerator and condensing unit control wires, plus the 36 circuits to the CPU power supplies. CRI will install miscellaneous signal cables.

Floor preparation (see Floor Cutout drawing):

Cut out floor tile and remove stringer as shown. Additional floor support may be required to keep cut floor tile in place.

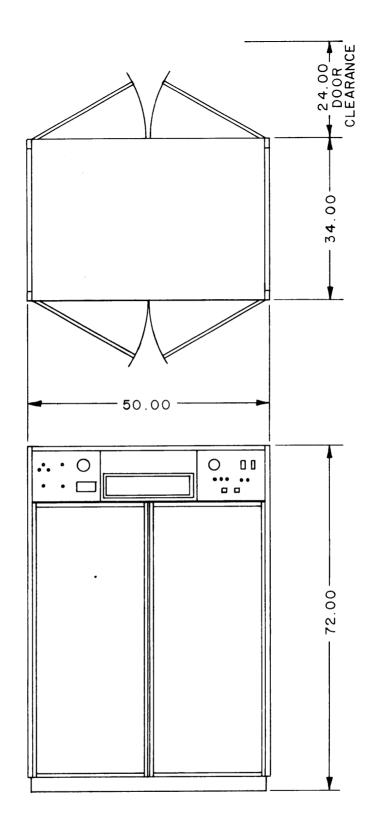

CRAY I COMPUTER POWER DISTRIBUTION CABINET


POWER REQ'D: SIX, 60 AMP, 208 V, 3ø, 400 Hz CIRCUITS

ONE, 15 AMP, 115 V, 60 Hz CIRCUIT

APPROX. WT.: 1500 lbs

APPROX. ROOM HEAT LOAD: 4000 BTU/HR

REVISIONS REV. ECO. DESCRIPTION DRFT. DATE APP'D

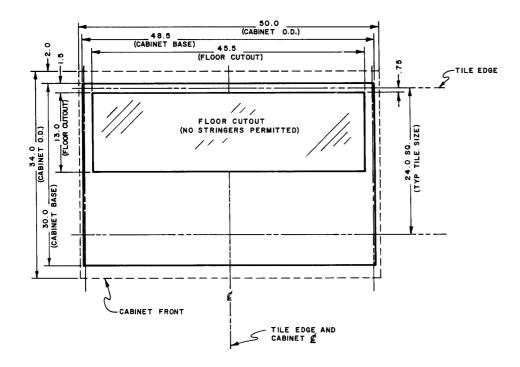

NOTE:

- 1. FRONT 3 INCHES OF CUTOUT USED FOR ENTRANCE OF 6-60 AMP, 3 PHASE, 400 Hz CIRCUITS(11/2" KO'S)
 2. REAR 8 INCHES OF CUTOUT USED FOR POWER CABLES TO MAIN FRAME (36-3/4" KO'S) PLUS 8-1/2" KO'S FOR MISC. CABLES.

ITEM	REQ'D	PART NUMBER	DESCRIPTION	MATERIAL					
	LIST OF MATERIAL								

i	LIST OF WA	OF WATERIAL						
MATERIAL	CI			SEARCH	TITLE	9 O W	ER (
FINISH	L	IN	CORF	ORATED	INSTALLATION			
Fillian	PROJECT			TOLERANCES (EXCEPT AS NOTED)	CRAY-1 C			
	•	BY	DATE	Ι΄ ;			PART	
REMOVE ALL BURRS	DRWN	Land	6/6/75	FRAC. — /	PREFIX	SIZE	PARI	
BREAK SHARP EDGES & CORNERS			7.,	DEC /		С		
DO NOT SCALE	APP.	<u> </u>	-	ANG. — • /	SCALE	1/8	WEIGHT	

F	9 O W	/ER	CABINE	Т				
INST	ALLA	TION	INFORMATION					
CRAY-1 COMPUTER								
PREFIX	SIZE	P	ART NUMBER	REV.				
	_							

SHEET

PART NUMBER

REV.

CRAY-1 CONDENSING UNIT (two required)

Description:

Twenty-horsepower water-cooled condenser with controls for high, low, and oil pressures. Cabinet can be furnished with skins, but if units are installed in equipment room side skins will not be furnished.

Wiring (see Power Wiring schematic and Condensing Unit Installation drawing):

Customer installed.


Piping (see Condensing Unit Installation drawing):

Water:

1-1/4-inch pipe, locations per drawing.

Refrigerant:

Sizes per drawing. Customer to provide access fittings for line evacuation after unit is attached. Specific drawings for individual site will be furnished by CRI.

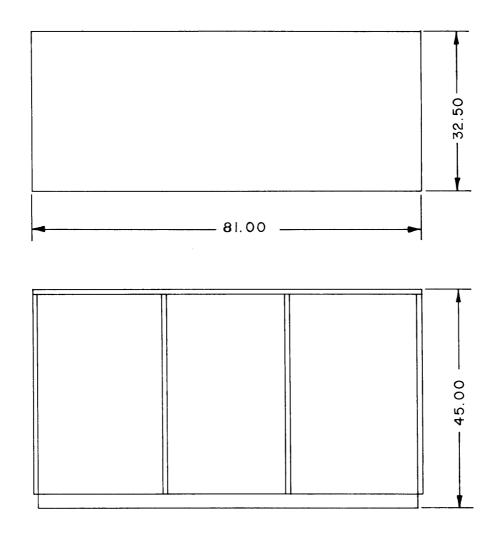


CRAY I COMPUTER CONDENSING UNIT


POWER REQ'D: 50 AMP, 460 V, 3ø, 60 Hz CIRCUIT

WATER REQ'D: 45° TO 75°F(20 GPM, 3 PSI DROP of 75°F)

APPROX. WT.: 1400 lbs

ESTIMATED ROOM HEAT LOAD: 18000 BTU/HR

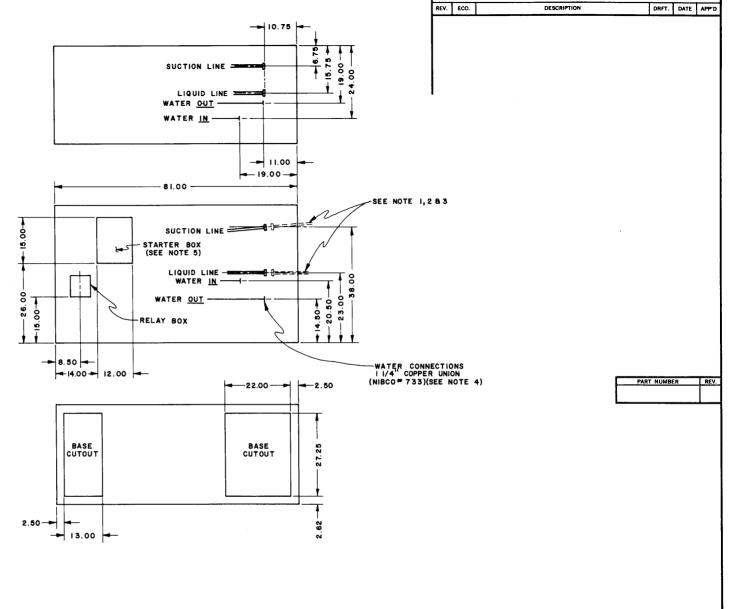



NOTE

- Suction line (Customer-installed): 1 5/8 0D copper with Mueller Brass A5148 tongued flange.
- Liquid line (Customer-installed): 1 1/8 0D copper with Mueller Brass A8629 tongued flange.
- General refrigeration notes:
 - a. Both installed lines to have vibration eliminators.
 - b. Refrigeration lines can be taken out either side or the end (as shown) by removal of panels if installed in remote location from computer. If installed in computer room, lines must be taken out the bottom.
 - c. Solder connections to be made with silver solder, and good refrigeration practices to be followed for cleanliness.
 - d. Prior to opening condensing unit valves, system must be charged with R-22 and dry nitrogen to 300 PSIG and tested with an electronic detector that detects leaks at 1/2 oz/year or less.
 - Refer to general "under-floor" piping arrangement.
 Specific installation information will be furnished by CRI to fit the site and the computer to be shipped.
- 4. Mater required: 45° to 75° (20 GPM, 3 PSI drop @ 75° F). If available water is over 75° F, factory must be advised. Water can be brought out similar to refrigeration lines (see note 3b). The union half (which is part of Customer's plumbing) will be furnished by CRI.
- Power (50 amp, 460 volt, 3 phase, 60 Hz) for unit is brought into the bottom, top, or left side of the starter box. If computer room installed, bottom only.
- Relay box connections made through the bottom only with 2 cond, 14 gauge wire to second condensing unit or power cabinet.

DESCRIPTION MATERIAL ITEM REQ'D PART NUMBER LIST OF MATERIAL MATERIAL CRAY RESEARCH CONDENSING UNIT INCORPORATED INSTALLATION INFORMATION TOLERANCES CRAY-1 COMPUTER (EXCEPT AS NOTED) BY DATE REFIX SIZE PART NUMBER FRAC. — ± REV. REMOVE ALL BURRS DRWN 24 6/9/75 C RREAK SHARP FOGES & CORNERS CHK'D DEC. -- ± SCALE I/I6 WEIGHT SHEET ANG. - ± DO NOT SCALE


CRAY-1 MOTOR-GENERATOR (two required)


Description:

150 KVA, 208 volt, 3 phase, 400 Hz output motor-generator. 200 HP, 480 volt, 3 phase, 60 Hz drive motor and a 10 HP pony start motor. Each motor-generator with a control cabinet.

Wiring:

Units are wired both for running with the outputs hooked together through the control cabinets for alternate operation and for standby usage.

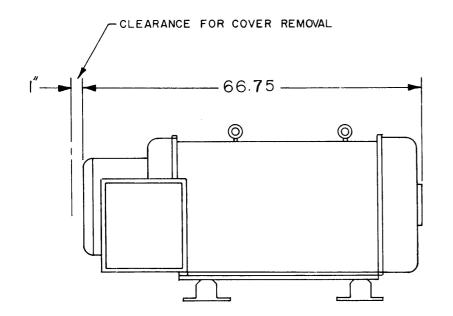




150 KVA MOTOR GENERATOR

250 AMP, 460 V, 3ø, 60 Hz

200 HP MOTOR, IO HP PONY-MOTOR

APPROX. WT.: 3900 lbs

APPROX. ROOM HEAT LOAD: 90,000 BTU/HR

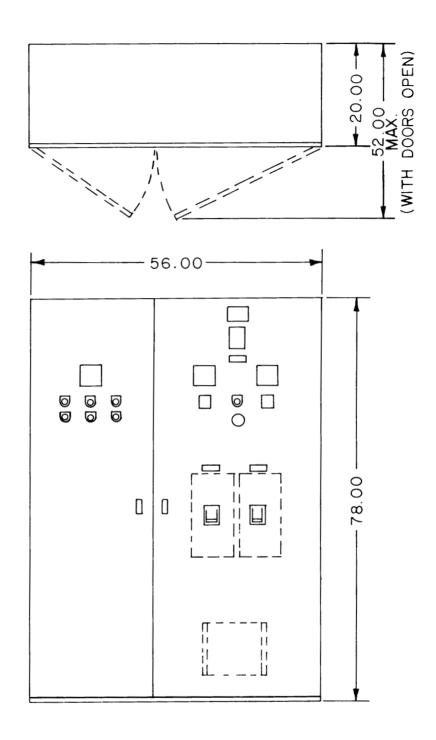

CONTROL CABINET, MOTOR GENERATOR

APPROX. WT.: 1100 lbs

CRAY-1 MCU I/O SYSTEM

This system consists of a CPU, tape drive, and controls in a rack-mounted package plus a disk pack drive, line printer, card reader, and two terminal displays. A four-foot desk and a stand are provided for the terminals.

CPU-tape drive unit:

Fan cooled using room air. Attached drop cord for 208-volt power and external male receptacle for standard 115-volt extension cord.

Disk-pack drive:

Power from control in above unit. Power and logic cables furnished.

Line printer:

Standard 115-volt extension cord-furnished by CRI.


Card reader:

Standard 115-volt extension cord--furnished by CRI.

Terminal displays:

Standard 115-volt extension cord--furnished by CRI. <

Customer is to provide the means to plug in all of the above equipment.

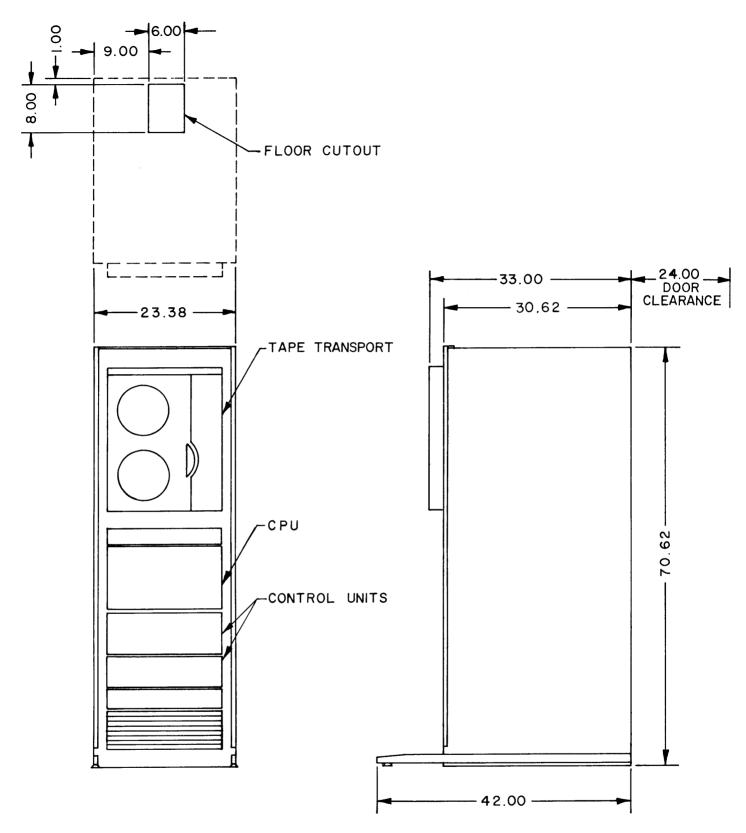


CPU, TAPE & CONTROL UNIT CRAY I MCU

POWER REQ'D: 208 VAC, 30, 60 Hz, 20 AMP CIRCUIT 115 VAC, 60 Hz, 15 AMP CIRCUIT

WEIGHT: APPROX: 500 lbs

ROOM HEAT LOAD: APPROX. 6000 BTU/HR

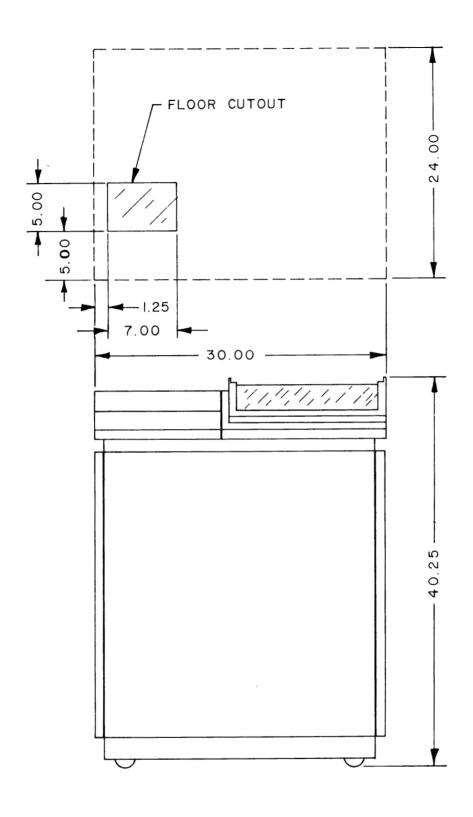


DISC-PACK DRIVE CRAY I MCU

POWER REQ'D: FROM CONTROL UNIT - 208 OR 230 VAC,

SINGLE PHASE, 60 Hz

APPROX. WT.: 350 lbs

ROOM HEAT LOAD: 1570 BTU/HR

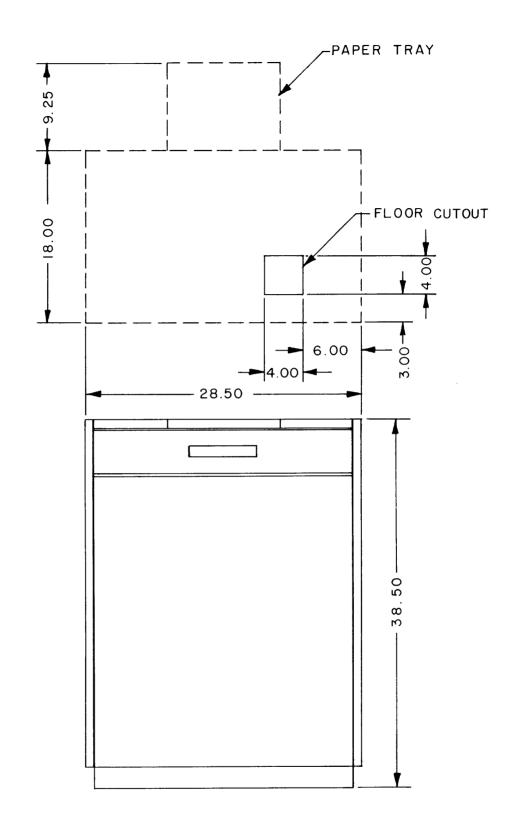


PRINTER CRAY I MCU

POWER REQ'D: 115 VAC, 10, 60 Hz, 15 A CIRCUIT

WEIGHT: 195 lbs

ROOM HEAT LOAD: 2000 BTU/HR

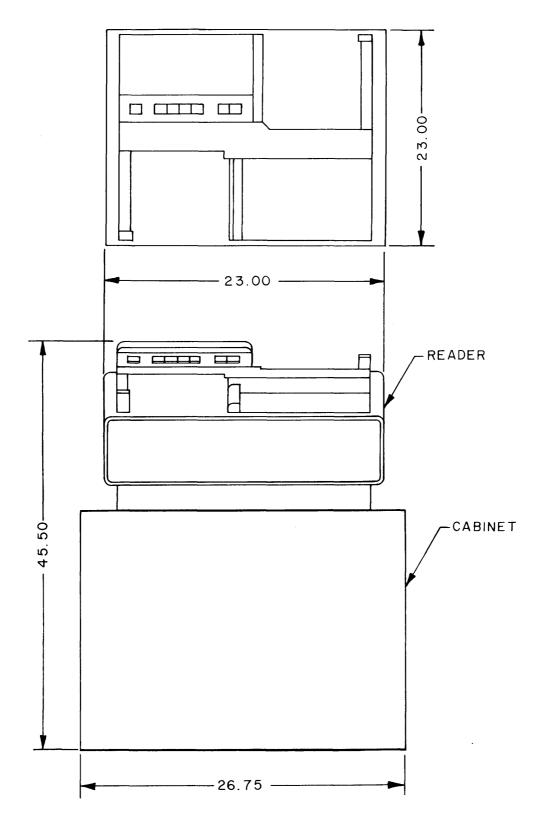


CARD READER CRAY I MCU

POWER REQ'D: 115 VAC, 10, 60 Hz, 15 AMP CIRCUIT

WEIGHT: 160 lbs

ROOM HEAT LOAD: 2050 BTU/HR(MAX)

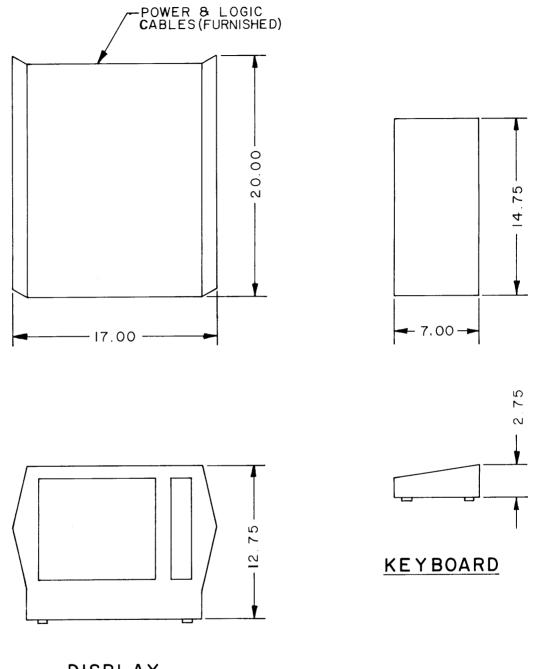


DISPLAY

DISPLAY TERMINAL CRAY I MCU

POWER REQ'D: 115 V, 60 Hz, 15 A CIRCUIT

HEAT DISSIPATION: 350 BTU/HR

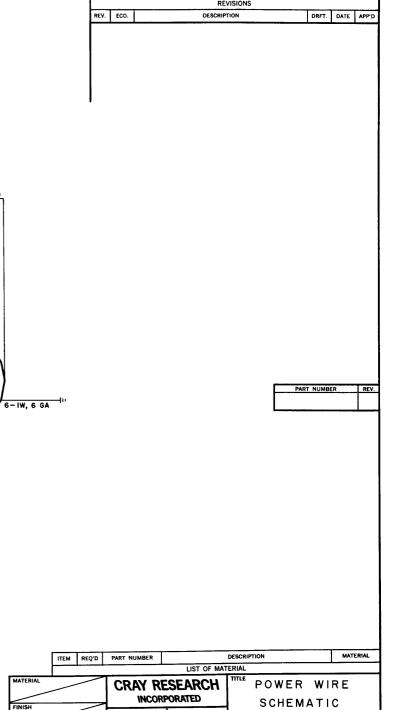

2-15 AMP, 115 V, 10 2-3W, 14 GA

MAIN Frame

60 Hz

BREAKER PANEL

36 - 4 W, 14 GA

M-G CONTROL

SEE ELECTRIC MACHINERY
DRWGS FOR INTER-CONNECTIONS NOTE: WIRE SIZES SHOWN MAY BE CHANGED DEPENDING UPON LOCAL CODES, WIRE INSULATION USED AND LENGTH OF RUNS.

2 W, 14 GA

TO 400 Hz Breaker Panel

8W, 3/0

M-G CONTROL

CONDENSING

UNIT# I

2W, 14 GA

50 AMP, 480 V

250 AMP, 480 V, 3Ø

4 W, 300 MCM 250 AMP, 480 V, 3Ø 4W, 300 MCM

4W, 8 GA

CONDENSING

UNIT# 2

400 Hz


BREAKER PANEL

POWER CABINET


MATERIAL PROJECT CRAY-1 TOLERANCES (EXCEPT AS NOTED) (COMPUTER INSTALLATION) BY DATE
DRWN 2 6/6/75 PART NUMBER PREFIX | SIZE REMOVE ALL BURRS С BREAK SHARP EDGES & CORNE CHK'D SCALE ANG. - ± WEIGHT SHEET DO NOT SCALE


BRUNING 40-21 500-6-72

480 VOLT 60 Hz, 3 PH BREAKER PANEL

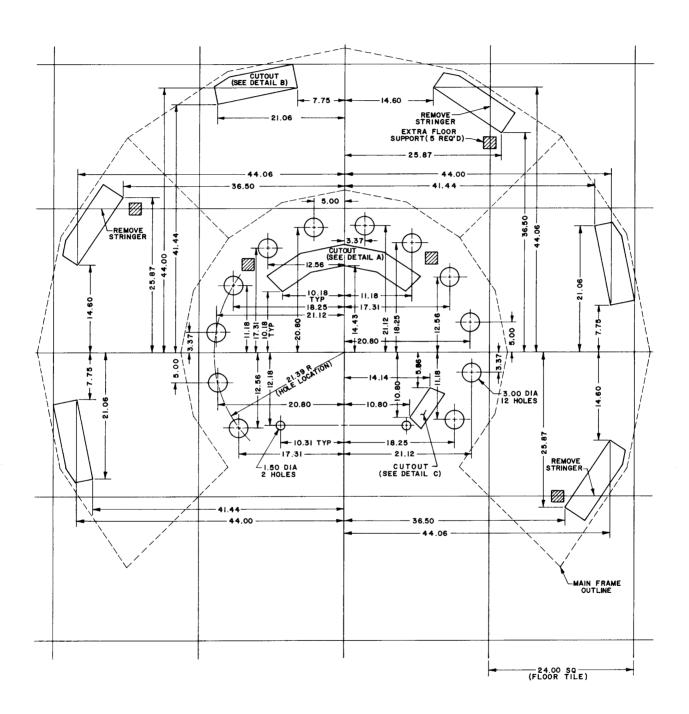


REVISIONS										
REV.	ECO.	DESCRIPTION	DRFT.	DATE	APP'D					
_		·								

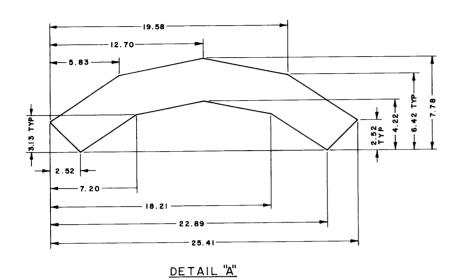



DETAIL"B"



NOTE:

1. DO NOT EDGE FLOOR CUTOUTS UNLESS EDGING
18 FLUSH OR BELOW FLOOR SURFACE.

			ITEM	REQ'D	PART	NUMB	ER		DESCRIP	TION	MAT	ERIAL	
Т	1		LIST OF MATERIAL										
3		MATERIAL			CRAY RESEARCH INCORPORATED				TITLE FLOOR CUTOUTS				
PART N									MAIN FRAME				
NUMBER					PROJECT CRAY - 1			TOLERANCES (EXCEPT AS NOTED)		SERIAL 2 & UF			
	l	DEMOVE	ALL BURRS		2000		Y DATE	FRAC ±	PREFIX	SIZE	PART N	UMBER	REV.
		BREAK SHARP EDGES &				2M4	6/10//3	DEC ± .12	D				
P.		DO N	OT SCAL	E	APP.			ANG ±	SCALE	1/8	WEIGHT	SHEET)F

